


ADJACENT TO WALL OR BUILDING

SIDEWALK

ADJACENT TO LAWN AREA

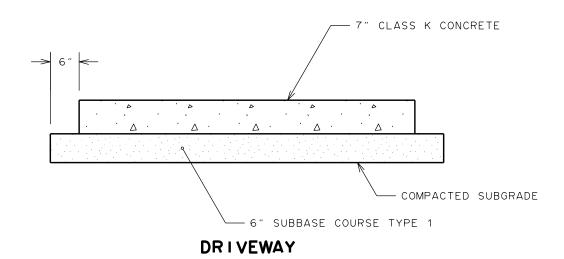

## NOTES:

- 1. MAXIMUM CROSS-SLOPE OF CONCRETE SIDEWALK IS 1:50.
- 2. ENTIRE AREA OF SIDEWALK ACCESS RAMP AND LANDING PAD IS TO BE 7 INCH THICK CONCRETE.
- 3. PROVIDE ½INCH WIDE EXPANSION JOINT BETWEEN NEW CONCRETE CONSTRUCTION AND BACK EDGE CURB, CONCRETE GUTTER, OTHER PAVED AREAS, BUILDINGS, WALLS, POLE BASES AND OTHER STRUCTURES/APPURTENANCES.
- 4. FOR EXPANSION JOINT USE  $\frac{1}{2}$  INCH WIDE PREMOULDED EXPANSION JOINT MATERIAL, SEALED WITH  $\frac{1}{2}$  INCH WIDE CAULKING SEALANT  $\frac{1}{8}$  INCH DEEP.
- 5. SEE DETAILS S608-25 FOR HEAVY-DUTY COMMERCIAL DRIVEWAY PAVEMENT SECTION.

CITY OF ROCHESTER

## CONCRETE SIDEWALK AND DRIVEWAY

ISSUED	9 - 2 - 91	STANDARD
REVISED	5 - 1 - 13	DWG.NO.R608-6